

General Purpose Digital Controllers Specifications

DC1010 - DC1020 - DC1030 - DC1040

51-52-03-33 August 2003



Overview

The DC1000 family of microprocessor based controllers combines a high degree of functionality and reliability at a very low price. Available in 4 different formats: 1/16 DIN, 1/8 DIN, 3/16 DIN, 1/4 DIN. These controllers are ideal for regulating temperature in a variety of applications, including

- Dryers.
- Semiconductor packaging / testing.
- Plastic processing.
- Packaging machinery.
- Painting and coating.
- Climatic chambers.

The DC1000 family provides basic control requirements, plus advanced features such as motor position control, phase angle power control and Setpoint programming.

Features

Easy to configure

Two different configuration levels provide easy access to parameters. A 4-digit security code prevents unauthorized changes. Parameters can also be hidden to the user to prevent mis-configuration of the unit.

Various Control algorithms

The DC1000 series of controllers provide several different algorithms:

- PID or ON/OFF control.
- Heat/Cool algorithms with 2 different PID sets.
- Motor position control without slidewire feedback.
- Single phase control, with or without zero crossover control.
- Three phase control, with or without zero crossover control.



DC1010 (1/16 DIN)

DC1020 (1/8 DIN)



DC1030 (3/16 DIN)

DC1040 (1/4 DIN)

Dual display and Bar graph

Two large 4 digits displays and one 10 LED bar graph display PV, SP and configuration parameters. Up to 8 LEDs display the status of the different Outputs (Control, Alarm,) and also provides indication of the Auto/Manual and Programmer states.

Setpoint Programming

Two programs are available, with a maximum of 8 segments. The 2 programs can be linked together to form a single 16 segment program.

Extended Alarm capability

Three different alarm outputs are available per instrument, 17 alarm modes are configurable.

Autotuning capability**Communications**

RS232 or RS485 ASCII protocol is optionally available. Up to 30 DC1000 Controllers can be connected to a single host computer. The host computer can change the SP, monitor the PV, the output or change the configuration of the unit.

Remote Setpoint capability**Manual / Automatic modes****Universal Power supply**

Operates on any voltage from 85Vac to 265Vac at 50/60Hz.

Large operating range

These instruments can operate from -20°C to $+65^{\circ}\text{C}$ (-4°F ~ 149°F)

Specifications

Technical data		
PV Input	Type of Input	Thermocouples : K, J, R, S, B, E, N, T, W, PL II, U, L RTD : Pt100, JPt100, JPt50 Linear : 4~20mA
	Input Sampling Time	500 ms
	Input Resolution	14 bit (each)
	Indication	PV/SP Indication
	Constant Value Storage System	Non-volatile memory (E ² PROM)
	Indication Accuracy	0.5%FS
Control Mode	Proportional Band (P)	0~200% (On/Off action at P=0)
	Integral Time (I)	0~3600 sec (PD action at I=0)
	Derivative Time (D)	0~900 sec (PI action at D=0)
	Cycle Time	0~150 sec (4~20mA=0, SSR=1, Relay=10)
	Dead Band Time	0~1000 sec (dead time compensation)
Output	Relay Output	Electromechanical relay <ul style="list-style-type: none"> • SPDT contacts • 3A/240Vac
	Static relay driver output	Voltage Pulse, 20VDC/20mA
	Current & Voltage outputs	0~20mA, 4~20mA, 0~5V, 0~10V, 1~5V, 2~10V
	Motor Control Output	Servo motor valve control (open loop circuit)
	Others	Phase angle control : 1φ SSR, 3φ SSR, 1φ SCR, 3φ SCR


Technical data		
Alarm	Number	Up to 3 (optional)
	Modes	17 alarm modes available, ability to ignore the alarm the first time it occurs : <ul style="list-style-type: none"> ✓ Deviation high or low alarms. ✓ Deviation alarms. ✓ Band alarm. ✓ High or low alarm. ✓ End of segment alarm. ✓ Programs run indication alarm. ✓ Timer alarm.
	Timer	One timer is associated with each alarm.
Retransmission output	Output Signal	SP, PV
	Type of Output	4~20mA, 0~20mA, 0~5V, 0~10V, 1~5V, 2~10V
2nd Input (Remote SP)	Type of Input	4~20mA, 0~20mA, 0~5V, 0~10V, 1~5V, 2~10V
	Sampling Time	500 ms.
Programs	Number	2 programs of 8 segment each.
Communication	Type of Communication	RS-232 or RS-485. ASCII protocol.
Operating conditions	Rated Power Supply Voltage & Frequency	AC 85 ~ 265V, 50/60Hz
	Power Consumption	8VA (110V), 12VA (220V)
	Ambient Temperature	-20°C ~ 65°C (-4°F ~ 149°F)
	Ambient Humidity	50 ~ 85% RH (non condensing)
Approvals		UL Pending. CE Mark.

TC & RTD Types & ranges							
		°C			°F		
TC	K	0.0~200.0 °C	0.0~400.0 °C	0.0~600.0 °C	0.0~392.0 °F	0.0~752.0 °F	0.0~1112.0 °F
		0.0~800.0 °C	0.0~1000 °C	0.0~1200 °C	0.0~1472.0 °F	0.0~1832.0 °F	0.0~2192.0 °F
	J	0.0~200.0 °C	0.0~400.0 °C	0.0~600.0 °C	0.0~392.0 °F	0.0~752.0 °F	0.0~1112.0 °F
		0.0~800.0 °C	0.0~1000 °C	0.0~1200 °C	0.0~1472.0 °F	0.0~1832.0 °F	0.0~2192.0 °F
	R	0.0~1769 °C		0.0~1769 °C	0.0~3216.0 °F		0.0~3216.0 °F
	S	0.0~1769 °C		0.0~1769 °C	0.0~3216.0 °F		0.0~3216.0 °F
	B	0.0~1820 °C			0.0~3308.0 °F		
	E	0.0~800 °C		0.0~1000 °C	0.0~1472.0 °F		0.0~1832.0 °F
	N	0.0~1200 °C		0.0~1300 °C	0.0~2192.0 °F		0.0~2372.0 °F
	T	-199.9~400.0 °C	-199.9~200.0 °C	0.0~350.0 °C	-199.9~752.0 °F	-199.9~392.0 °F	0.0~662.0 °F
	W	0.0~2000 °C		0.0~2320 °C	0.0~3632.0 °F		0.0~4208 °F
	PL II	0.0~1300 °C		0.0~1390 °C	0.0~2372.0 °F		0.0~2372.0 °F
	U	-199.9~600.0 °C	-199.9~200.0 °C	0.0~400.0 °C	-199.9~999.9 °F	-199.9~392.0 °F	0.0~752.0 °F
	L	0.0~400.0 °C		0.0~800.0 °C	0.0~752.0 °F		0.0~1472.0 °F

TC & RTD Types & ranges							
RTD	Pt 100	-199.9~600.0 °C	-199.9~400.0 °C	-199.9~200.0 °C	-199.9~999.9 °F	-199.9~752.0 °F	-199.9~392.0 °F
		0.0~200.0 °C	0.0~400.0 °C	0.0~600.0 °C	0.0~392.0 °F	0.0~752.0 °F	0.0~1112.0 °F
	JPt 100	-199.9~600.0 °C	-199.9~400.0 °C	-199.9~200.0 °C	-199.9~999.9 °F	-199.9~752.0 °F	-199.9~392.0 °F
		0.0~200.0 °C	0.0~400.0 °C	0.0~600.0 °C	0.0~392.0 °F	0.0~752.0 °F	0.0~1112.0 °F
	JPt 50	-199.9~600.0 °C	-199.9~400.0 °C	-199.9~200.0 °C	-199.9~999.9 °F	-199.9~752.0 °F	-199.9~392.0 °F
		0.0~200.0 °C	0.0~400.0 °C	0.0~600.0 °C	0.0~392.0 °F	0.0~752.0 °F	0.0~1112.0 °F

Control Algorithms

- PID or ON/OFF control
- Heat/Cool algorithms with 2 different PID sets
- Phase angle control

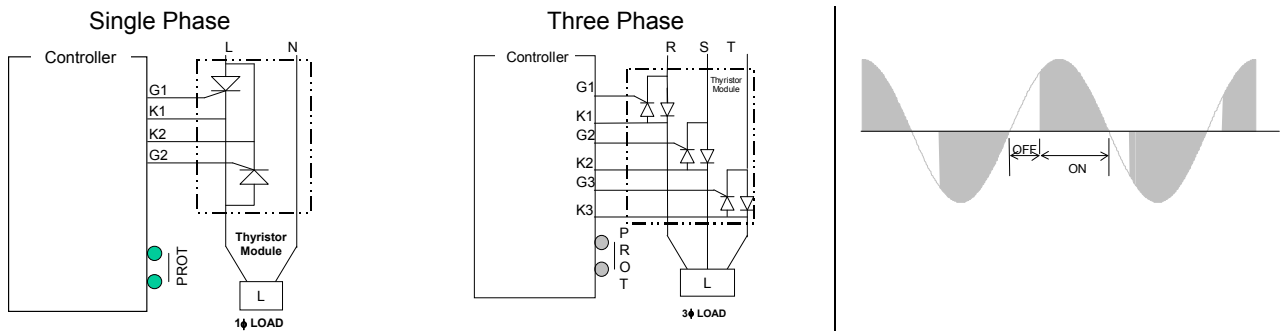



In phase angle control, power is regulated by changing the point at which the SCR is turned on within each 1/2 period.

Single Phase: Output is changed every half-cycle in response to output signals from the Temperature Controller.

Three Phase: The outputs are changed every 120° in response to signals from the Temperature Controller.


Using this form of control, high-precision temperature control is possible.

- Zero-crossover control

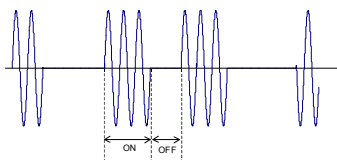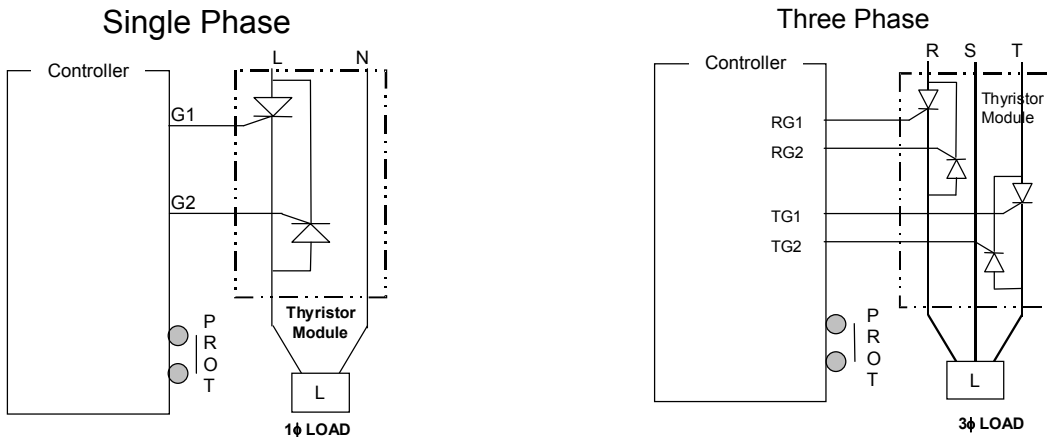

The term Zero-Crossover means that the SCR's are turned on only when the instantaneous value of the sinusoidal wave is zero. Power is then applied for a several continuous half-cycles and then removed for several half-cycles to achieve the desired load power.



• **Motor position control without slidewire Feedback**

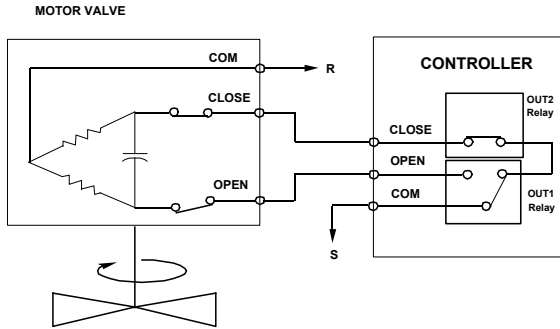

Motor position is achieved by using time proportional control without the need for slidewire feedback from the motor shaft.


Slidewires wear over a period of time, which can result in poor or intermittent control. This type of control reduces maintenance requirements and removes the need for the controller to be calibrated to the motor feed back potentiometer.

EXTERNAL DIMENSIONS, PANEL CUTOUT

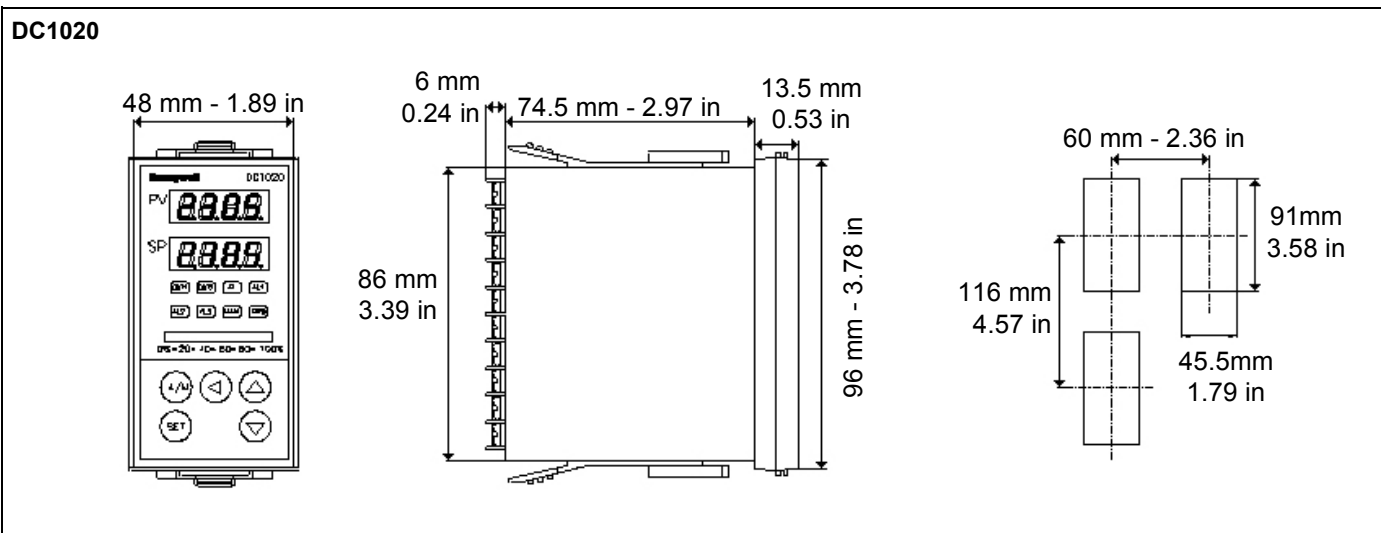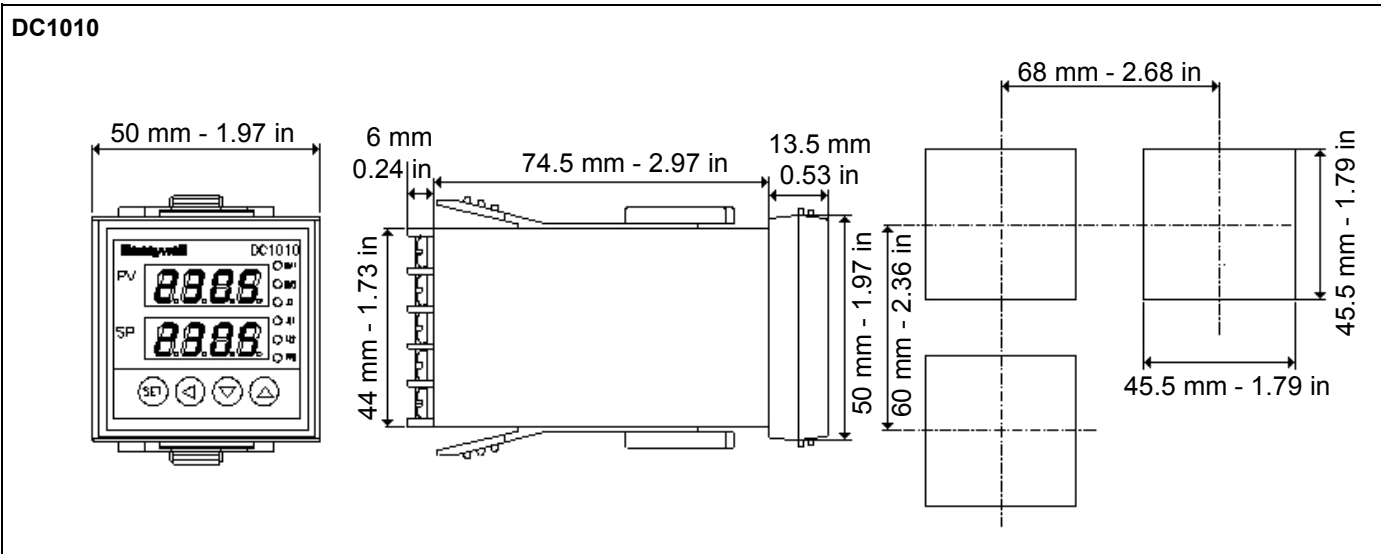





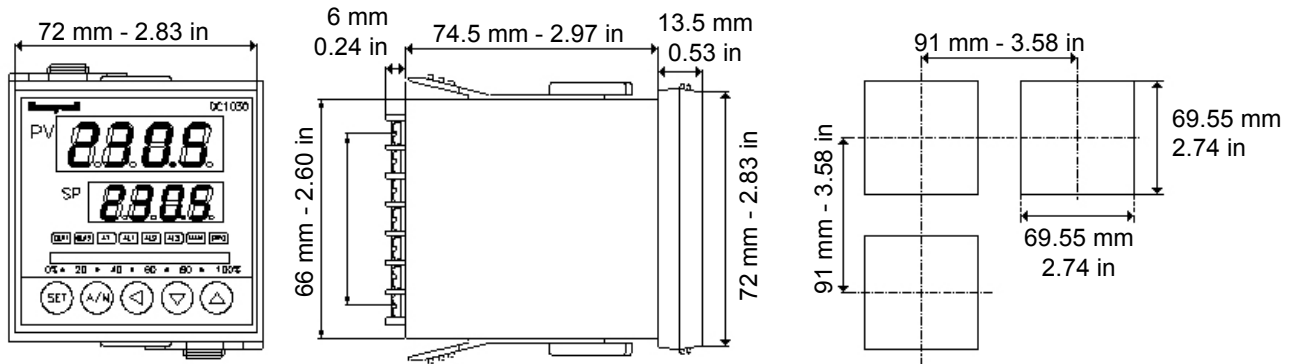


EXTERNAL DIMENSIONS, PANEL CUTOUT

DC1030

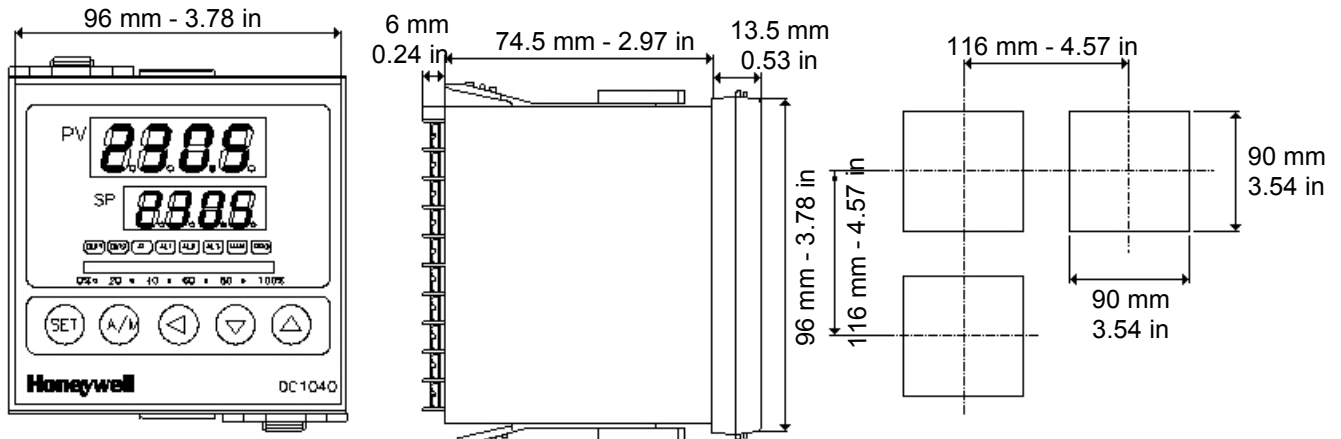

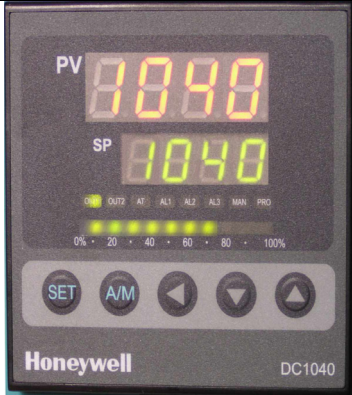
DC1040



HUMAN / MAN INTERFACE			
<p>Higher display: 4 digits dedicated to display the PV. In configuration mode, this display indicates the value of the parameter or the parameter selected.</p> <p>Lower display: 4 digits dedicated to display the SP°; In configuration mode, indicates the name of the parameter.</p> <p>Bar graph: A 10 green LEDs bar graph indicates the value of the output in percentage.</p> <p>LEDs:</p> <p>OUT1: Status of output 1.</p> <p>OUT2: Status of output 2.</p> <p>AT: When the LED is ON an automatic tuning of the parameters is on going.</p>			
<p>AL1: Status of alarm 1.</p> <p>AL2: Status of alarm 2.</p> <p>AL3: Status of alarm 3.</p> <p>MAN: ON if we are in Auto mode. OFF if manual mode.</p> <p>PRO: Flickers when a program is running. Continuously ON when a program is suspended. OFF when no program is running.</p>			
	<p>SET allows to change from one parameter to another. Pressing it for 5 seconds grants access to the configuration level 1 (PID parameters+locking the instrument).</p> <p>Pressing simultaneously for 5 seconds on the left arrow and SET grants access to the configuration level 2 (input type, alarms, SP limits, field calibration, communication parameters).</p>		
	<p>A/M allows to switch from Auto to Manual.</p>		<p>When modifying a parameter, pressing this key allows to change the digit to modify.</p>
	<p>Pressing this key decreases the parameter or digit being modified.</p>		<p>Pressing this key increases the parameter or digit being modified.</p>

MODEL SELECTION GUIDE

- Select the desired Key Number.
- Make One selection each from Tables I through III.

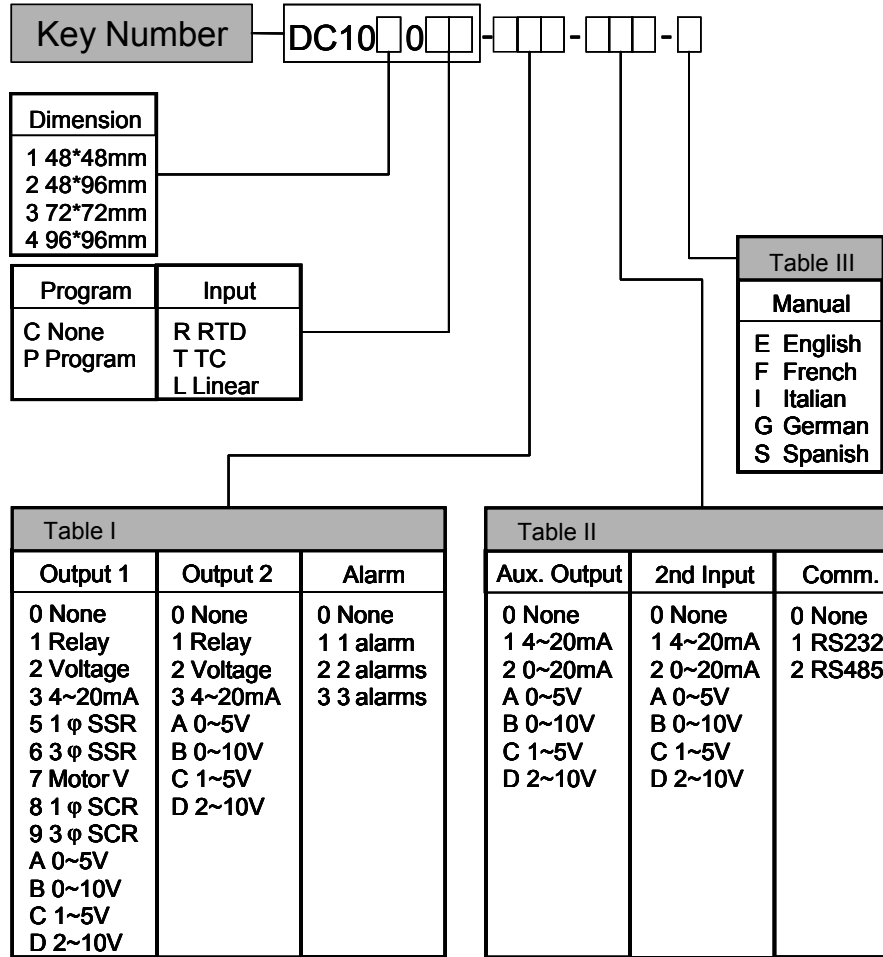

For More Information

Learn more about how Honeywell's Digital Controllers can provide a high degree of functionality and reliability, visit our website www.honeywell.com/ps/hfs or contact your Honeywell account manager.

Honeywell Process Solutions

1860 West Rose Garden Lane
Phoenix, Arizona 85027
Tel: 1-800-423-9883 or 1-800-343-0228
www.honeywell.com/ps

51-52-03-33
August 2003
© 2010 Honeywell International Inc.

Honeywell